

Dehumidifier Recusorb **DR-010B MH-1**



Dehumidifying capacity at 20°C / 60%RH

0.5 kg/h

Dry air flow

190 m³/h


- Built in humidistat
- Washable rotor
- No desiccant carry-over
- Self-regulating heater
- Easy to maintain
- Long lifetime

With humidistat; only for installations where the unit is installed in the dehumidified room.




Section of a dehumidifier rotor from Seibu Giken. The high number of channels means that moisture is adsorbed with extra efficiency.

World leaders in dehumidification.

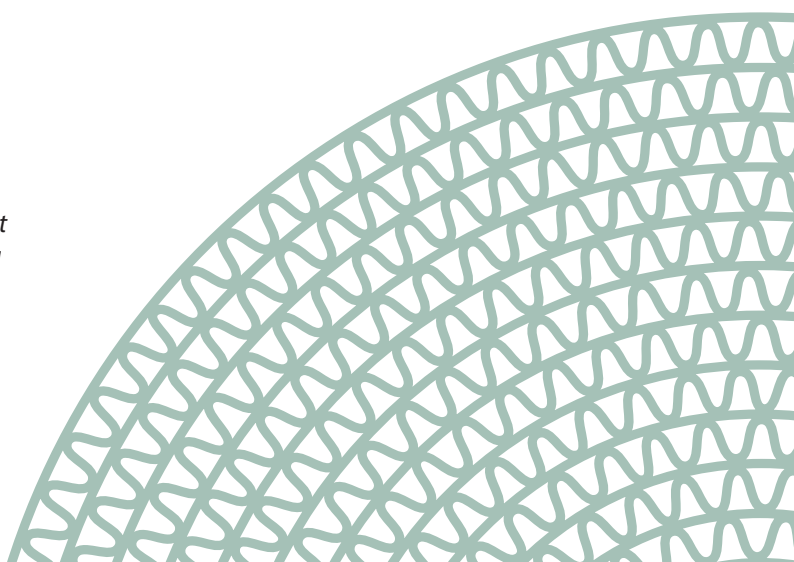


TECHNICAL DATA

| Dehumidifier model | DR-010B MH1 |
|---|-------------|
| Nominal capacity ¹ (kg/h) | 0,5 |
| Dry airflow ² (m ³ /h) | 190 |
| Wet air flow ² (m ³ /h) | 40 |
| Heater current ³ (A/W) | 3 / 690 |
| Maximum electric consumption (kW) | 0,8 |
| Supply fuse 230V / 50Hz (A) | 10 |
| Weight (kg) | 12 |

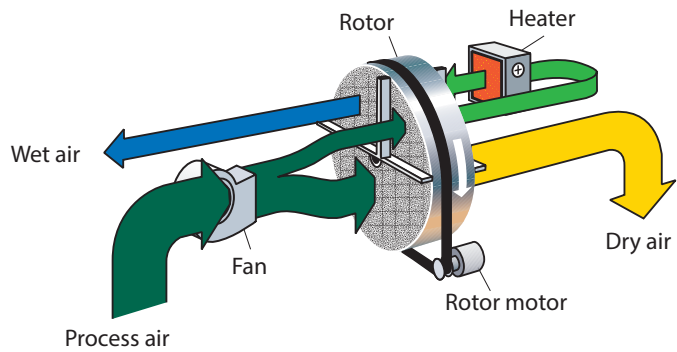

1. Valid for inlet conditions 20°C/60%RH. For other inlet conditions the capacity can be calculated by using the correction factor from the diagram shown below.
2. Volume flow for density 1.20 kg/m³. Free blowing.
3. The design of the PTC heater enables the power to be regulated by controlling the wet air flow.

CORRECTION DIAGRAM

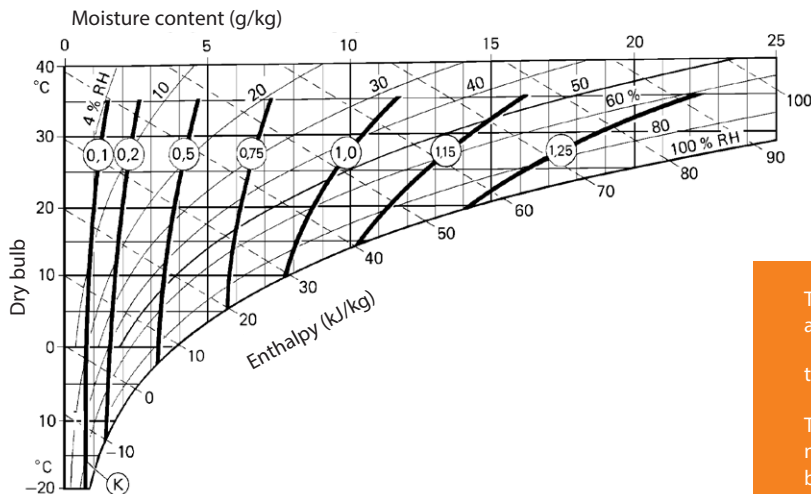


The temperature of the dry air at nominal air flows is calculated by:

$$t_{out} = t_{in} + (K \times 4) + 3$$

The dehumidifying capacity is estimated as the nominal capacity from above, multiplied by factor (K) from the correction diagram.

DIMENSIONS

Subject to change without notice. Download installation drawing at www.dst-sg.com

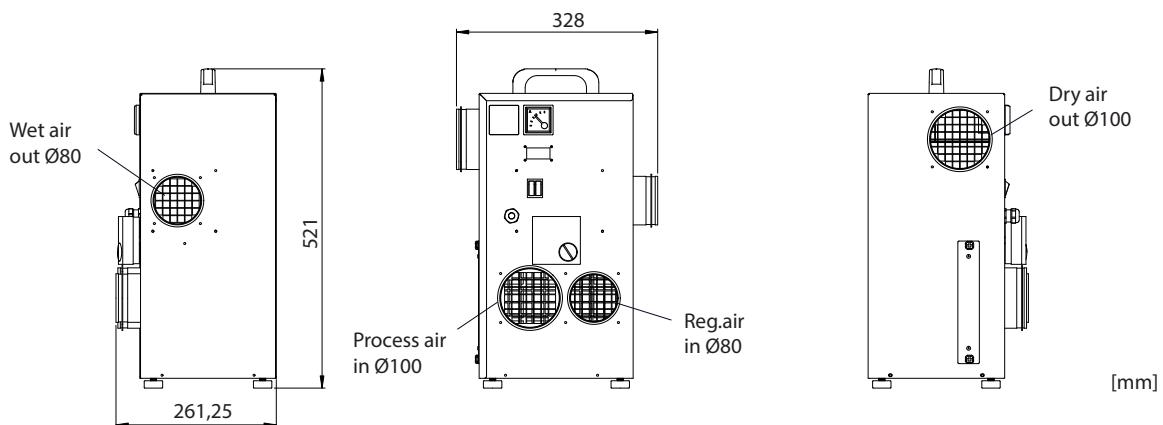

Updated 18.12



Sweden | +46 8 445 77 20
info@dst-sg.com | www.dst-sg.com